


PLAN VIEW

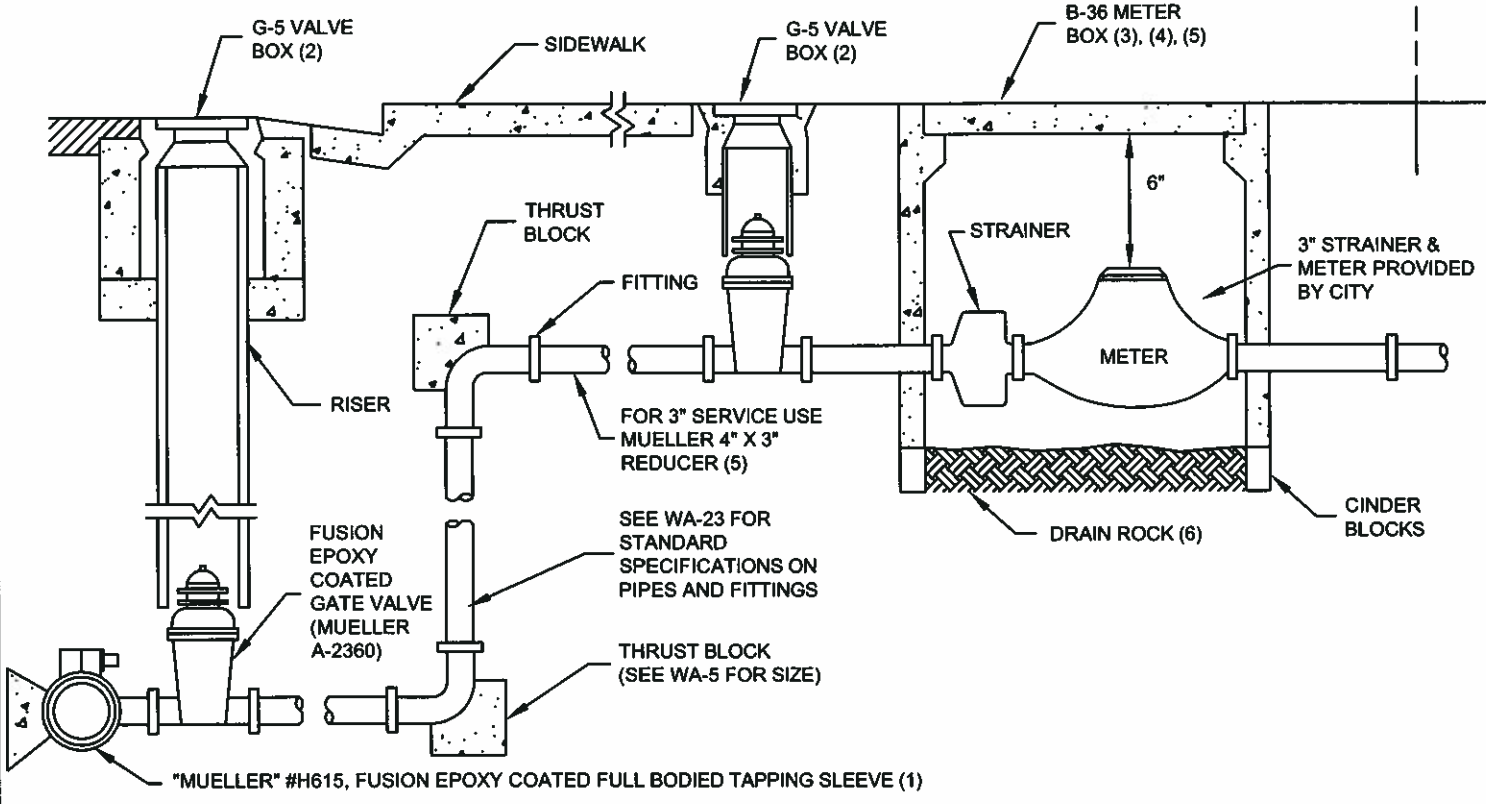

ELEVATION VIEW

NOTES:

1. FOR 3" METER, TAP MAIN WITH 4" TAP THEN USE MUELLER 4" X 3" REDUCER BEFORE GATE VALVE.
2. VALVE BOX AND COVER SHALL BE G-5 WITH COVER MARKED "WATER." USE 8" PVC OR SDR-35 PIPE FOR RISER.
3. METER SHALL BE ON PUBLIC RIGHT-OF-WAY, EASILY ACCESSIBLE TO METER READER, AND NOT BEHIND LANDSCAPING OR OTHER OBSTRUCTIONS.
4. THE METER AND METER BOX MAY BE ROTATED 90° TO COMPENSATE FOR SPACE REQUIREMENTS.
5. FOR 4" TURBINE METER WITH STRAINER USE BOX SIZE B-40 WITH METER READING LID.
6. USE 6" OF 3/4" DRAIN ROCK, CINDER BLOCKS WHEN SETTING METER BOX IN DIRT ONLY.

CITY OF MENLO PARK STANDARD DETAILS



NO.	REVISIONS	DATE

76 and 102mm (3", 4")
WATER SERVICE

APPROVED

 SENIOR ENGINEER, R.C.E. No. 061203

DRAWN MC	CHECKED VKFP	DATE 03/07/08	SCALE NTS	SHEET
-------------	-----------------	------------------	--------------	-------

STANDARD DETAIL NO. WA-22